

PRODUCTS					
PLOTID	NET QTY	PRODUCT	LENGTH	PLIES	
J 1	25	1 1-7/8" BCI® 5000-1.7 DF	32' 0"	1	
B 1	1	3-1/8"x12" GLU LAM ARCHITECTURAL SYP 26F-V5	32' 0"	1	
R 1	6	1-1/4" x 1 1-7/8" VERSA-STRAND® RIM 0.8 OSB	24' 0"	1	



NOTE:
ALL MEASUREMENTS
TO BE VERIFIED
IN THE FIELD.

Boise Cascade

FLOOR FRAMING
1/4" = 1'-0"

NOTE:
CONTRACTOR TO VERIFY ALL
BEAM AND JOIST LENGTHS,
QUANTITIES, & SIZES BEFORE
ORDERING

JOIST TAGS: FLANGE DIMENSIONS	
WIDTH X DEPTH	
BCI 5000	2" x 1-1/8"
BCI 6000	2-5/16" x 1-1/8"
BCI 6500	2-9/16" x 1-1/8"
BCI 60	2-5/16" x 1-1/2"
BCI 90	3-1/2" x 1-1/2"

PLEASE VERIFY FOLLOWING ITEMS,
1. PLEASE VERIFY DESIGN LOADS USED.
2. PLEASE VERIFY ALL DIMENSIONS, BEARING WALLS AND PIER LOCATIONS.
3. PLEASE VERIFY BCI SIZE, SERIES AND SPACING USED.
4. PLEASE VERIFY BC BEAM SIZE AND PLACEMENT.

ORDERING MATERIALS BEFORE ITEMS HAVE BEEN VERIFIED MAY RESULT IN
INSTALLATION DIFFICULTIES AND OR DESIGN FAILURE.

GENERAL NOTES:
1) ALL BEAMS AND HEADERS PER PLAN U.N.O.
2) NAIL JOISTS TO ALL BEARING POINTS WITH (2) 8d NAILS, BCI RIM AND BLOCKING WITH (2) 8d NAILS AT 6" O.C.,
AND OSB RIM BOARD TO PLATE WITH 8d NAILS AT 6" O.C. OR 16d NAILS AT 12" O.C.
3) REFER TO BOISE CASCADE INSTALLATION GUIDE OR PRODUCT GUIDE FOR GENERAL
INSTALLATION REQUIREMENTS.
4) REFER TO ORIGINAL CONTRACT DRAWINGS FOR ITEMS NOT SHOWN ON THIS PLACEMENT PLAN.
5) BOISE CASCADE RECOMMENDS 1-1/8" FLOOR SHEATHING WITH JOIST SPACING OF 19.2" AND
24".
6) REFER TO BC CALC'S FOR BCI JOIST AND BEAM MINIMUM BEARING REQUIREMENTS.

DESIGN LOADS:







FLOOR:

40 PSF LL
15 PSF DL
L/480 LL @ 100 %

ROOF:

40 PSF LL
20 PSF DL
L/360 LL @ 115 %

FLOOR SYSTEM IS
NOT DESIGNED TO
SUPPORT ANY ROOF
LOADS, EXCEPT
WHERE NOTED ON
CALCS.

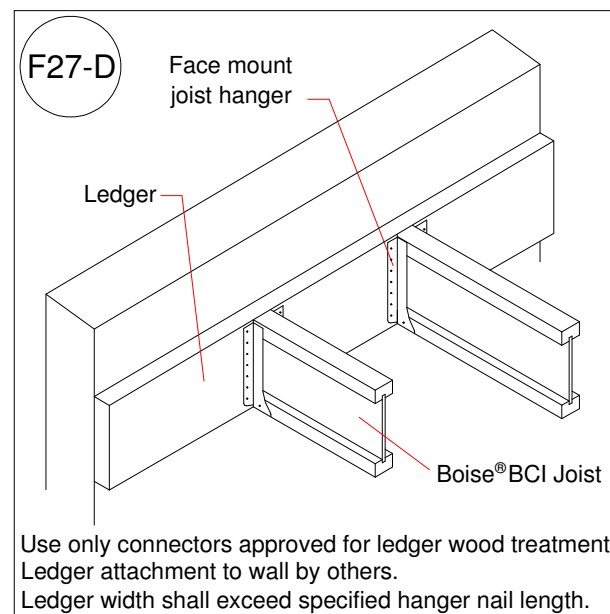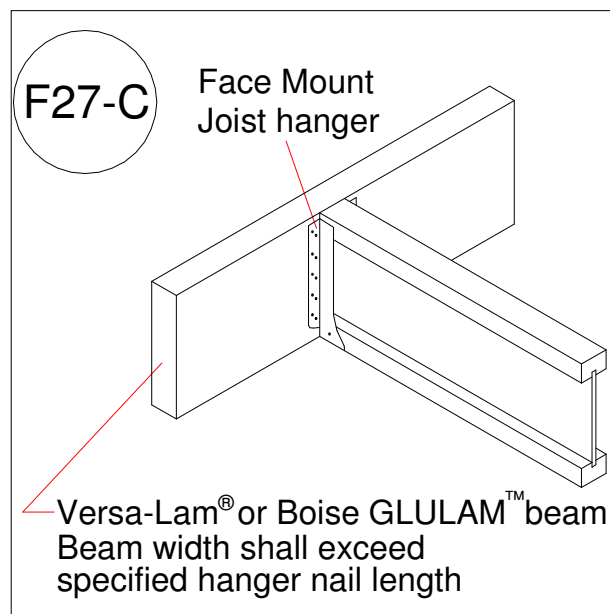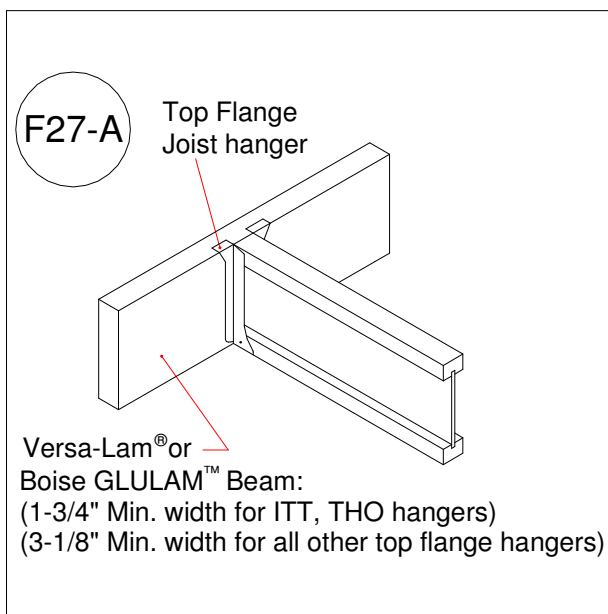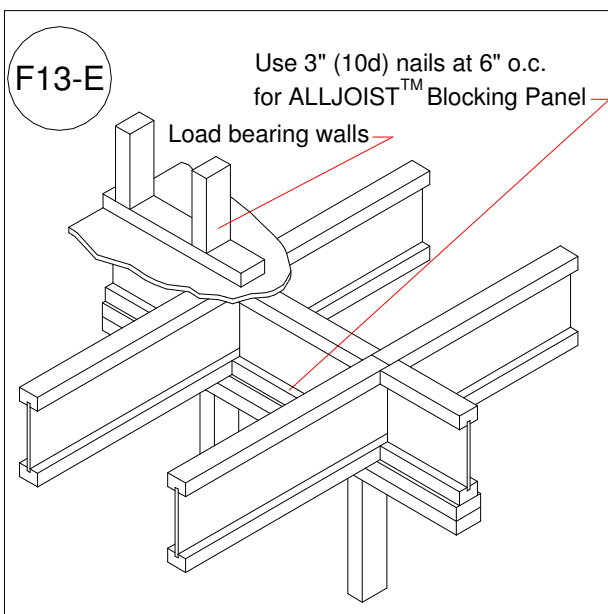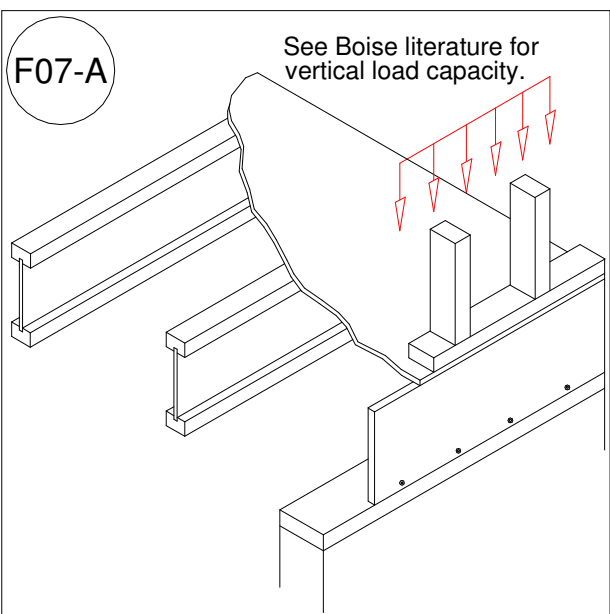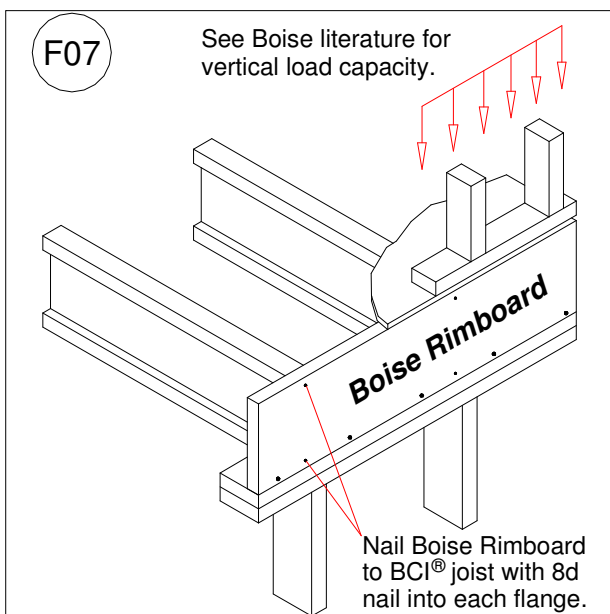

BC FRAMER

SCALE: AS NOTED

DATE:

BY: STEVEN DANTONIO

FILE: 18000922

DWG:

SHEET: 1 / 1