

ROOF PLACEMENT PLAN


SCALE: N.T.S

ROOF TRUSS CRITERIA	
BUILDING CODE	IRC2015
CONSTRUCTION LIVE LOAD	20.000 lb/ft²
TOP CHORD DEAD LOAD	10.000 lb/ft²
BOTTOM CHORD LIVE LOAD	0.000 lb/ft²
BOTTOM CHORD DEAD LOAD	10.000 lb/ft²
LIVE LOAD DEFLECTION	240
TOTAL LOAD DEFLECTION	180
ROOF AREA	2625.5 ft² sq ft
RIDGE LINE	0 ft
VALLEY LINES	0 ft
HIP LINES	0 ft
△ INDICATES LEFT END OF TRUSS	

REVISIONS		
DATE	DESCRIPTION	DSN
-8-22-23	-REMOVE B1G & (6)B2	-JY
.	.	.
.	.	.
.	.	.
.	.	.
.	.	.
.	.	.
.	.	.

DESIGNER SN2  
LAYOUT DATE 08/16/23  
ARCH DATE 07/25/22  
STRUC DATE N/A

JOB #: 23012075R

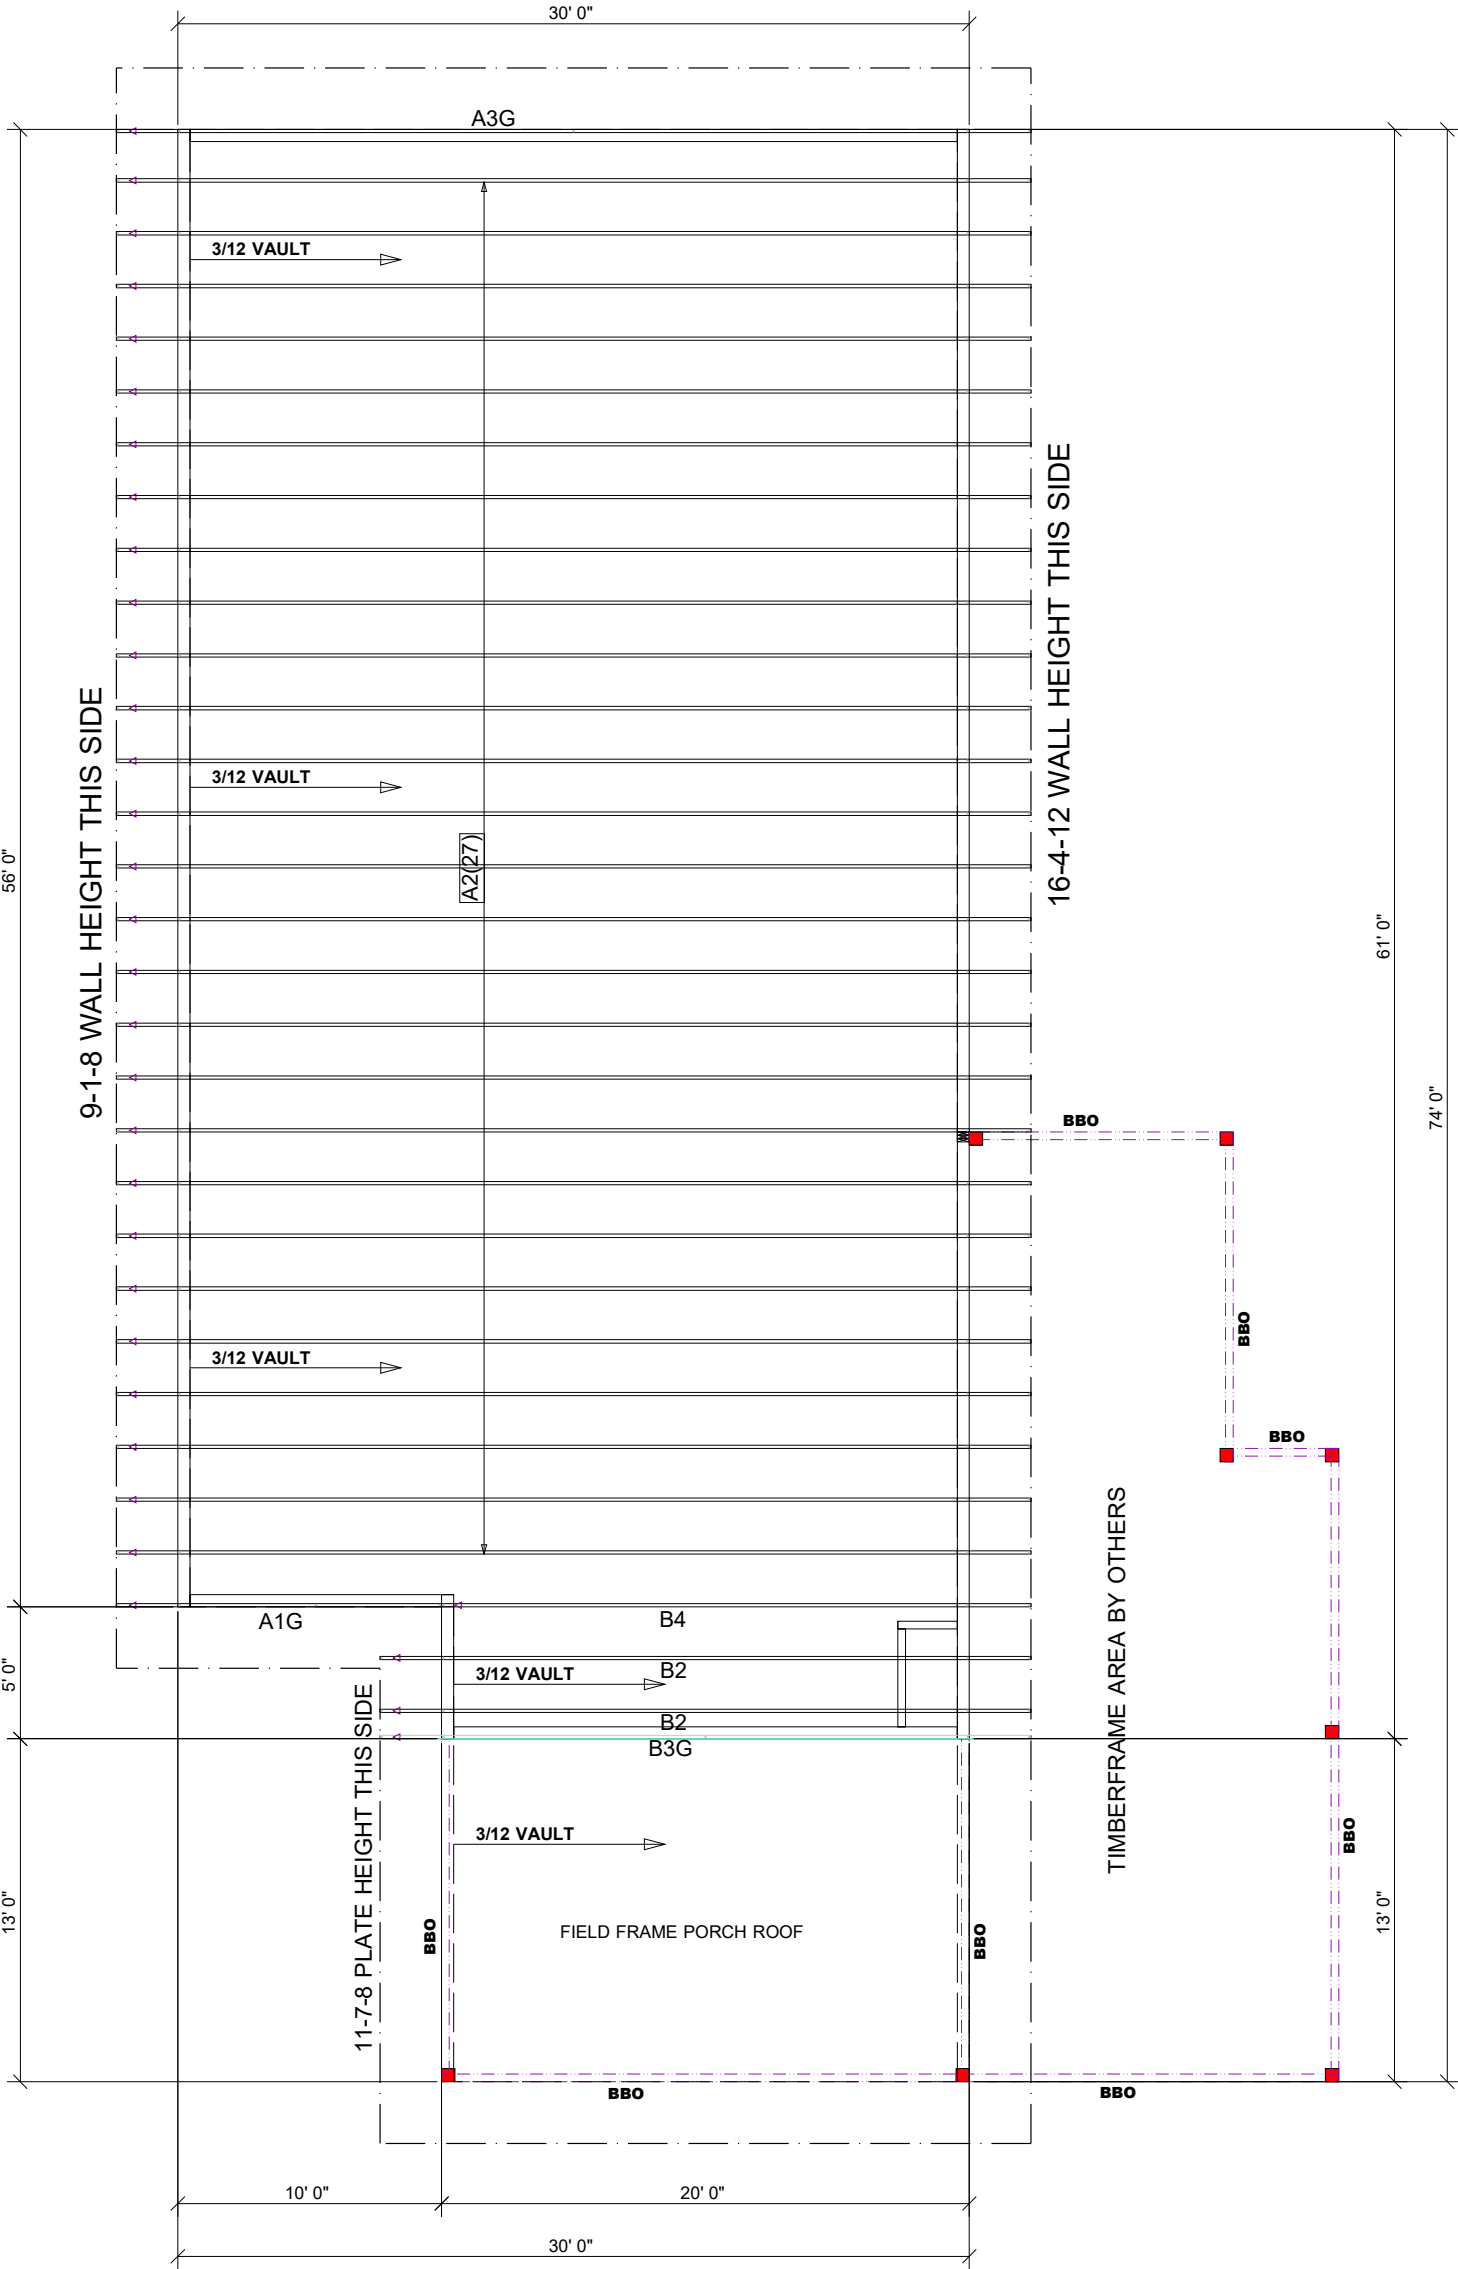

3/12 OVER 3/12 PARALLEL CHORD TRUSSES

22" DEEP WITH 28" OVERHANGS @ 24" ON CENTER

TRUSSES HAVE 2X6 TOP CHORD TO MATCH FIELD  
FRAMED 2X6 OUTRIGGERS. GABLES HAVE DROP TOP  
CHORDS FOR THE OUTRIGGERS.

BOONE, NC 28607

GREEN R PANEL